

Submittal

Job _____
 Location _____
 Submitted to _____
 Submittal Prepared by _____
 Approve Date _____
 Date _____

UL Classified - For use in UL 263 wood truss floor/ceiling assemblies rated 1 hour or less

Approved for use in **L-587***, **L-528**, **L-558**, **L-562**, **L-574**, and **L-585** Floor/Ceiling

P-556*, **P-533**, **P-545**, **P-547**, and **P-580** Roof/Ceiling
* ATI Exclusive Listings

Incorporates UL 555C evaluated ceiling damper

22 Ga CRD frame and blades

28 Ga box and collar with either 1½" R-6 or 2" R-8 duct liner insulation

Standard fusible link - 165° F (optional 212° F)

Standard Link attachment on 4" diameter and Easy Access Link attachment on 5" diameter and up




Ceramic Thermal Blanket provided on units with register openings of greater than 84 sq. in.

Available in range of sizes from 4" x 8" x 4" to 16" x 16" x 12"

Unique approval for Class 0, Class 1 Flex-duct *OR* steel pipe (elbow) connections to achieve "top-out" or "side-out" configurations

The **ONLY** UL tested and approved manufacturer offering this option

CRD Series 57 IB

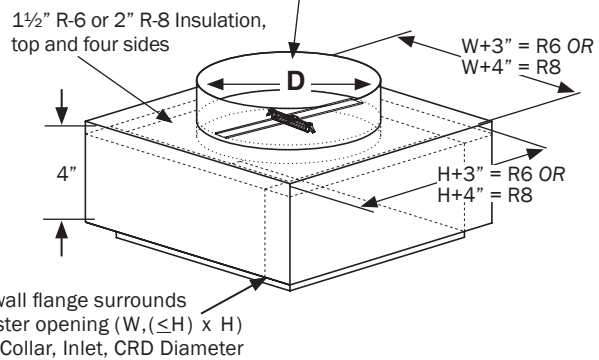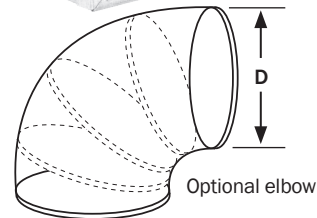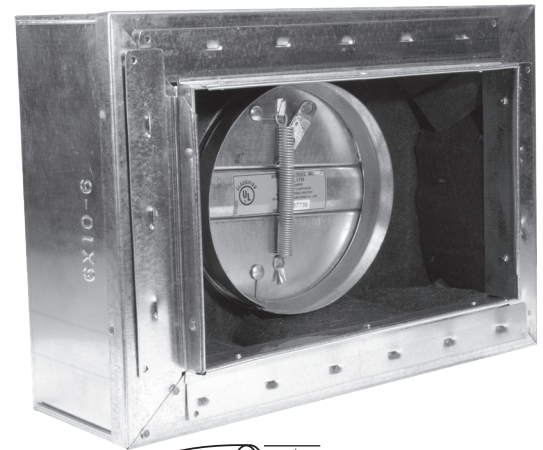


This product meets the requirements for ceiling dampers established by:

UL Standards 263 & 555C
NFPA Standard 90A
ICC Building Codes

Qty.	Register Opening		Fusible Link Temp (165° std.)	Collar Diameter	Insulation	Flange
	W	H				

Part Number Format

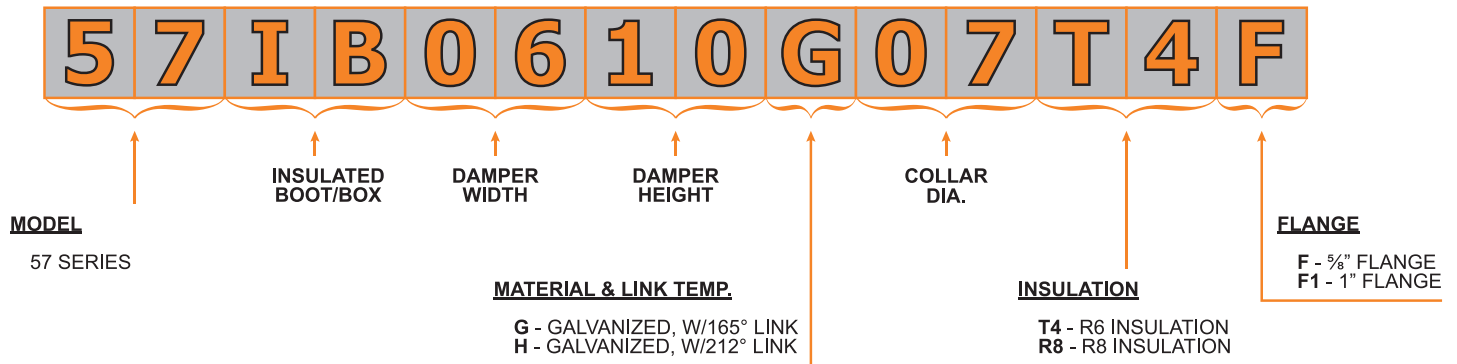

Submittal



AireTechnologies, Inc.
a DMI company

AireTechnologies, Inc.
1502 Industrial Drive
E. Monongahela, PA 15063

phone: 866.421.AIRE
fax 724.310.1262

www.airetechnologies.com