

Submittal

Job _____
 Location _____
 Submitted to _____
 Submittal Prepared by _____
 Approve Date _____
 Date _____

UL Classified (UL 263) - For use in wood truss floor/ceiling assemblies rated 1 hour

Approved for use in **L-587***, **L-528**, **L-558**, **L-562**, **L-574**, and **L-585** Floor/Ceiling

P-556*, **P-533**, **P-545**, **P-547**, and **P-580** Roof/Ceiling
* ATI Exclusive Listings

Incorporates UL 555C evaluated ceiling damper
 For use in register opening applications

22 Ga CRD frame and blades

Field installed 1½" R-6 or 2" R-8

Ductboard not included (58EAR)

Factory installed 1½" R-6 or 2" R-8




Ductboard included (58DR)

Standard fusible link - 165° F (optional 212° F)

Ceramic thermal blanket provided on units with CRD areas greater than 84 square inches

Available in range of sizes from
 4" x 8" to 20" x 16"

CRD Series 58 DR & EAR

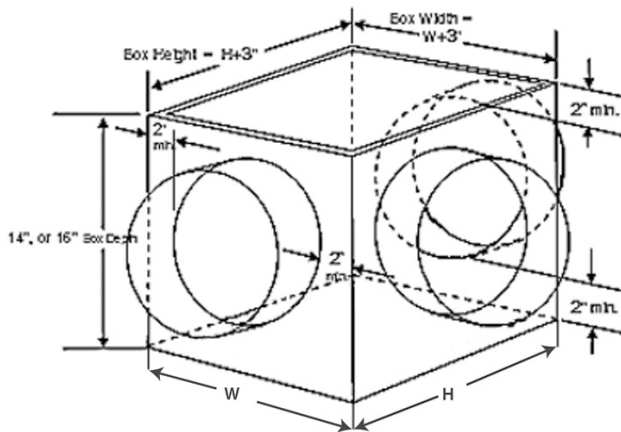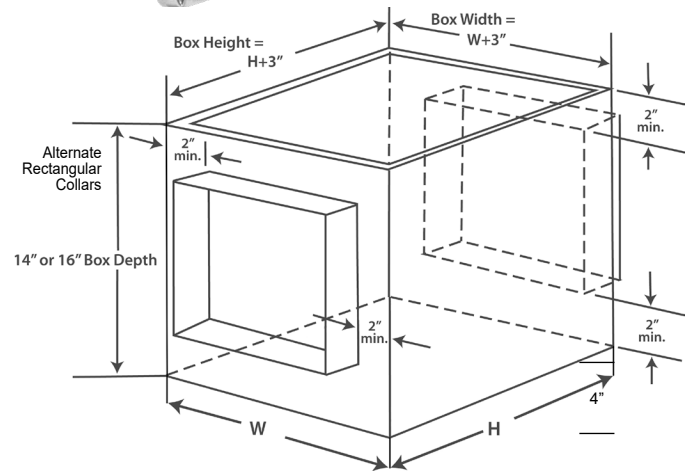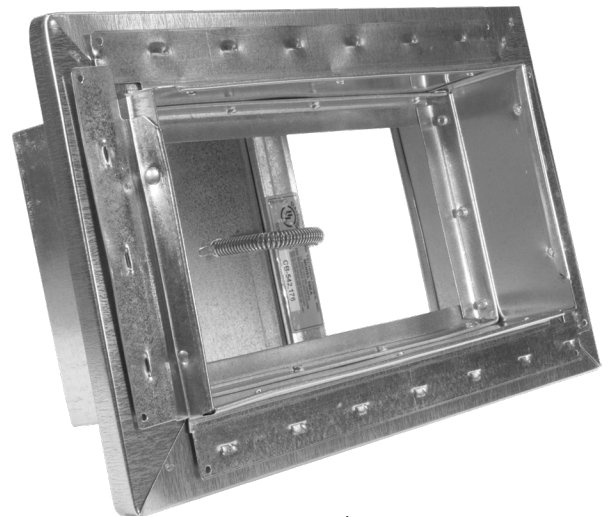


This product meets the requirements for ceiling dampers established by:

UL Standards 263 & 555C
NFPA Standard 90A
ICC Building Codes


Qty.	Damper Opening		Fusible Link Temp (165° std.)	Flange	Factory Installed Ductboard Box	
	W	H			Insulation	Box Height

Part Number Format

5 8 D R 1 6 1 2 G F R 6 1 6

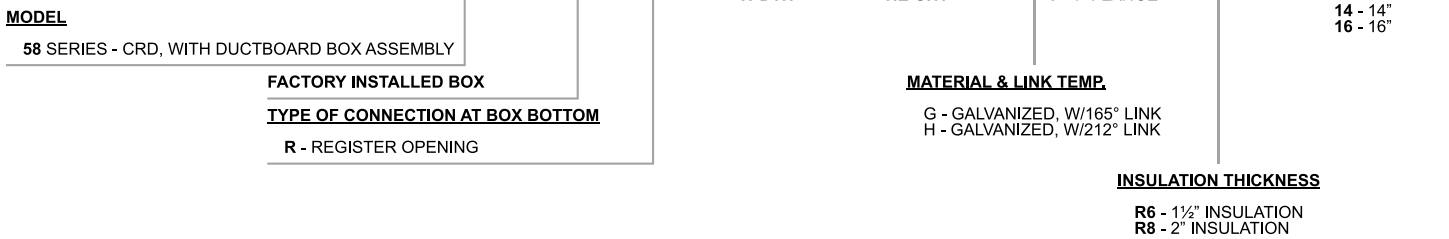

5 8 E A R 0 6 1 0 G F R 6

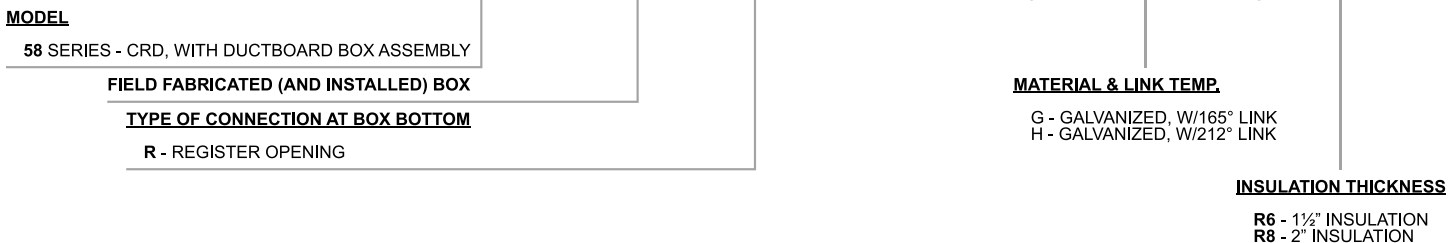

Submittal



Aire Technologies, Inc.
a DMI company

Aire Technologies, Inc.
1502 Industrial Drive
E. Monongahela, PA 15063

phone: 866.421.AIRE
fax 724.310.1262

www.airetechnologies.com